
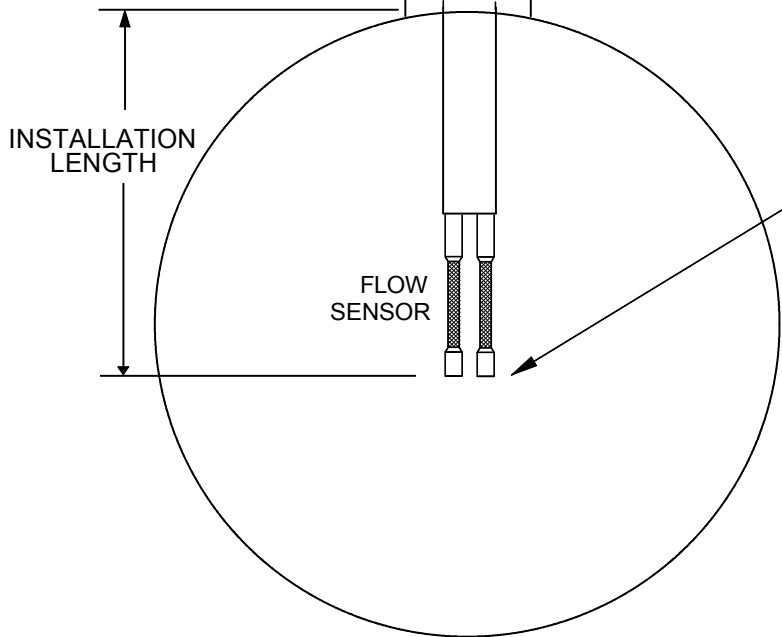



ELECTRICAL CONDULET



THE METER SHOULD BE INSTALLED IN A STRAIGHT LINE. THIS STRAIGHT LINE SHOULD HAVE A MINIMUM LENGTH OF 10 PIPE OR TUBE DIAMETERS AHEAD OF THE METER AND 5 AFTER THE METER.


FOR ALL LINE SIZES EXCEPT 2" AND 1 1/2"

DUAL TIP PROBE
INSTALLATION
LENGTH

POSITION BOTTOM OF THE DUAL TIPS THROUGH THE PIPE UNTIL REACHING 1/2 THE INSIDE DIAMETER PLUS 1/2"

FOR 2" SCH 40 PIPE
AND 1 1/2" SCH 40 PIPE

INSERT GENTLY UNTIL TIP TOUCHES BOTTOM THEN WITHDRAW 1/8"

SERIAL NO.	 Thermal Instrument Company 217 Sterner Mill Road, Trevoese, PA 19053, USA		
	DWG NO.: INSTALLATION LENGTH-62DT-PG	DESCRIPTION: INSTALLED DUAL TIP PROBE	
Thermal Instrument Company Proprietary Statement: <small>This drawing is the property of Thermal Instrument Company. Unauthorized use of this document is prohibited and subject to prosecution if violated.</small>	ORIGINATION DATE: 12/2/16	DRAWN BY: MJH	APPROVED BY: MJH
SCALE: NONE	MATERIAL: AS NOTED	PAGE: 1 of 1	